

Steps


1. With main power off. Connect 110 VAC to Wago 787-32 power supply. The RS-2 panel requires one (1) connection, with the RS-4 panel requiring two (2) connections. Connect black (load), white (neutral), and green (ground) wires accordingly.

(See figure 1).



Fig. 1

2. Please note, depending on the actuator model positive/negative wiring will be Red/Black or a Brown/Blue combination. Connect actuators to their respective groups (Group 1 – Group 4) via Red/Brown (positive) and Black/Blue (negative) wires. (See figure 2)

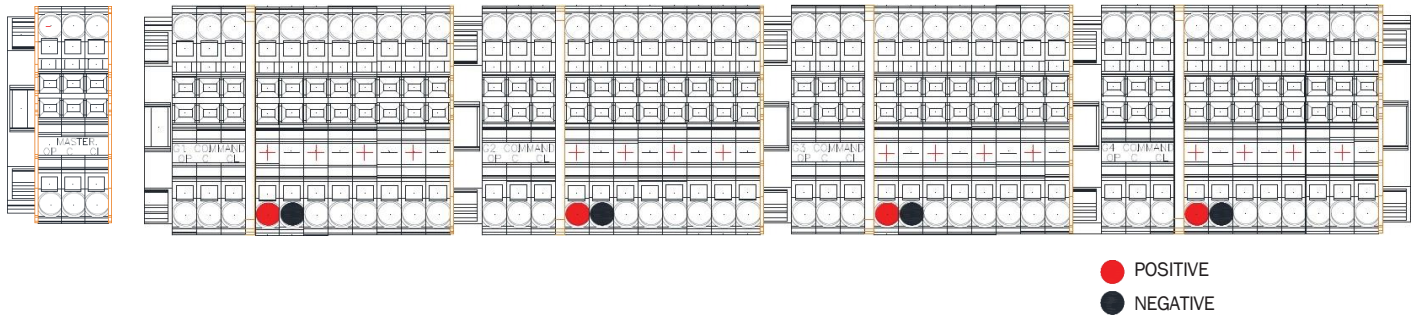

3. Connect Automation System or switch wires to the open, common, & close of the Master control terminal and/or various Sub control terminal Groups (1-4). NOTE: Common terminal on all group commands does carry a 24V DC current.

